











ONE-SWITCH CONTROL

2 AND 3-STAGE ARMS

OUICK CHANGE OF ADAPTERS

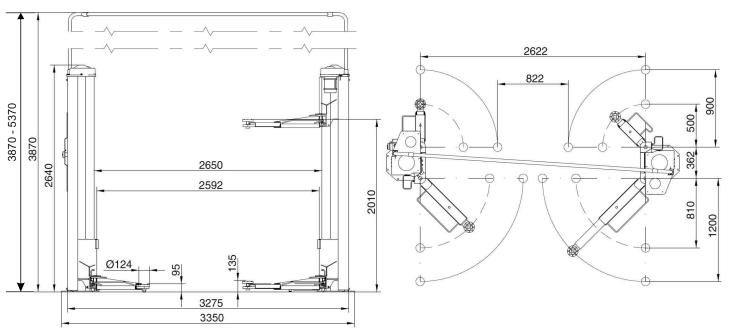



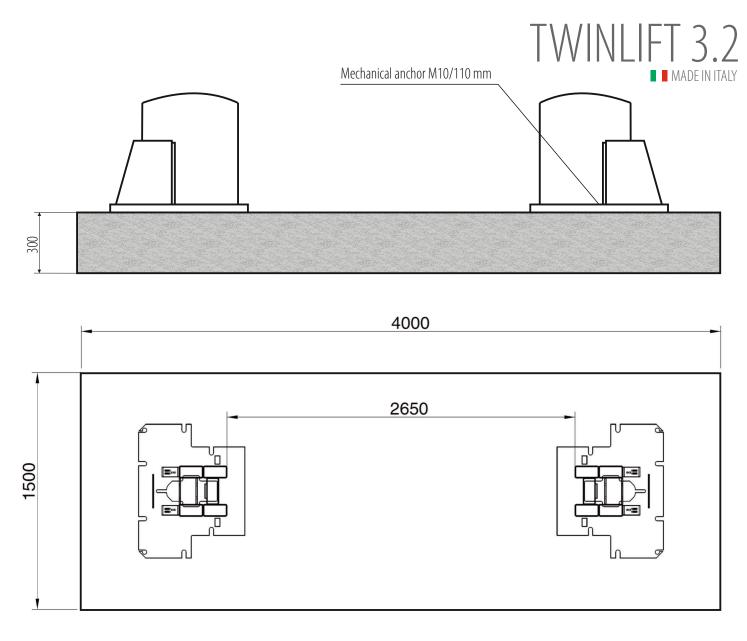

FLOOR DIMENSIONS: 4000x1500mm

INSTALLATION REQUIREMENTS:



Concrete class: B25 or C20 / 25 with a minimum mounting area: 4000x1500x300mm • Acceptable floor imbalance: +/- 5mm, floor execution: 3 weeks before assembly • Mounting anchors: mechanical M10 / 110 mm 16 pieces or chemical M10 / 110mm • Power supply: 5x2.5mm cable to the place of assembly • Current protection: min. 32A with 3-phase 400V / 50Hz power supply.

Installation allowed only in closed areas • prohibition of using reinforcement 20 cm from the top thicker than 4mm2 • assembly for chemical anchors for an additional fee (submit in advance, preferably when setting the date of assembly) • All connections, with particular reference to electrical connections, they must be made by authorized persons • The installation must remain carried out by qualified personnel according to the rules attached in this building plan • In the case of assembly by Nortec or its authorized service center, the lift must be on solid ground.